



**NETWORK
TECHNOLOGIES
INCORPORATED**

1275 Danner Dr Tel:330-562-7070
Aurora, OH 44202 Fax:330-562-1999
www.networktechinc.com

User's Guide

MADE IN
USA



E-BPT

Barometric Pressure Transmitter

Table of Contents

Section	Page
Section 1 - General Description	1
Section 2 - Unpacking	1
Section 3 - Theory of Operation	2
Section 4 - Specifications	2
Section 5 - Mounting	3
Section 6 - Transmitter Wiring Examples	3
Section 7 - Barometric Pressure to Analog Output Calculations	4

Section 1 - General Description

The E-BPT is a low cost, wall mounted barometer/transmitter. A temperature compensated, solid state pressure sensor measures atmospheric pressure. The measurement is then converted to an industry standard, user selectable 4-20 mA or 1-5 Vdc output signal scaled across the measurement range.

Section 2 - Unpacking

The following items are supplied in the box with your transmitter.

- This Manual (1 ea.)
- #6 Wall Anchor (2 ea.)
- #6 Mounting Screw (2 ea.)

Section 3 - Theory of Operation

A 4-20 mA loop is a series loop in which a transmitter will vary the current flow depending on the input to the transmitter. In the E-BPT, the amount of current allowed to flow in the loop will vary depending on the atmospheric pressure being measured by the sensor. Some advantages of a current output over a voltage output is that the signal measured is less susceptible to electrical noise interference and the loop can support more than one measuring instrument as long as the maximum loop resistance is not exceeded.

A typical application utilizing a current loop will normally consist of a power supply, the transmitter and a meter, recorder or controller to measure the current flow. The loop resistance is the sum of the measuring instruments and wire used. The maximum allowable loop resistance for the E-BPT to function properly is found by using the following formula:

$$R_{\max} = (\text{power supply voltage} - 8 \text{ volts}) / .02 \text{ amps}$$

Section 4 - Specifications


Range:	20.8 to 32 in Hg (10.20 to 15.72 psi)
Accuracy:	±1% FSO
Repeatability:	±.2% FSO
Pressure Hysteresis:	±.15% FSO
Long-Term Stability:	±.1% FSO/Year
Operating Temperature Range:	-20 to 140°F (-29 to 60°C)
Temp. Compensation Range:	32 to 140°F (0 to 60°C)
Output:	4 – 20 mA (scaled to full range)
Power Requirements:	8 –24 Vdc @ 20mA
Max Loop Resistance:	Ohms = (V supply – 8 V) / .02 A
RH Time Constant:	1 ms., from 10-90% FSO
Sensor Type:	Solid State
Media Compatibility:	Clean room air with a relative humidity less than 90% (non-condensing), non-corrosive gases
Enclosure Material:	Acrylonitrile Butadiene
Dimensions:	79 x 54 x 45mm (3.12 L x 2.12 W x 1.78" H)
Weight:	54 g. (.12 lbs)

NOTE:


These units are not designed, nor recommended for medical use, explosive environments or outdoor applications.

Section 5 - Mounting

The E-BPT is designed for wall mounting in locations that are free from dirt, grease, food particles and condensing moisture such as manufacturing clean rooms, computer rooms and laboratory type environments. Wall anchors and mounting screws are included for mounting. A conduit box mounting bracket/wall plate adapter kit is available that will allow the transmitter to be mounted to a standard electrical conduit box.

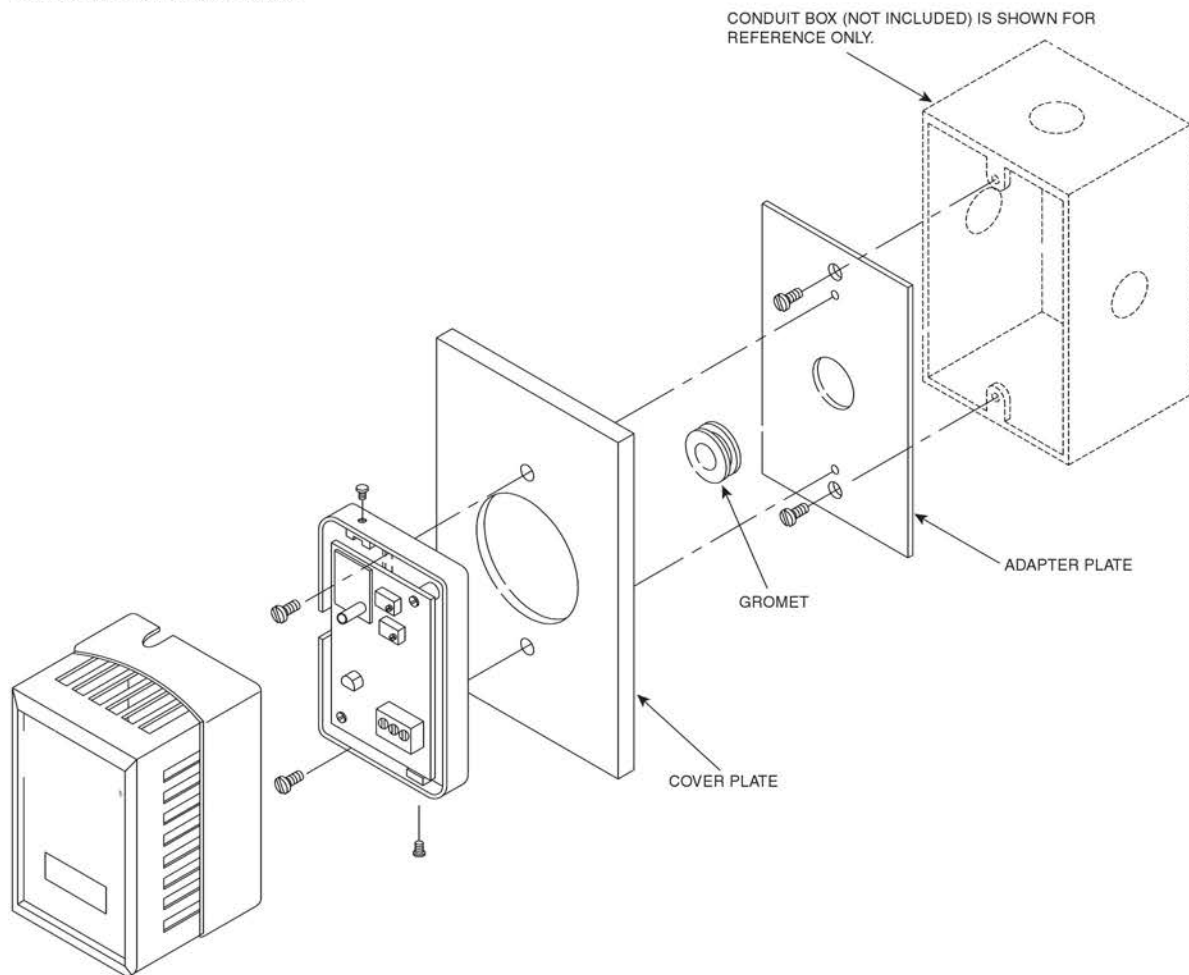

Section 6 - Transmitter Wiring

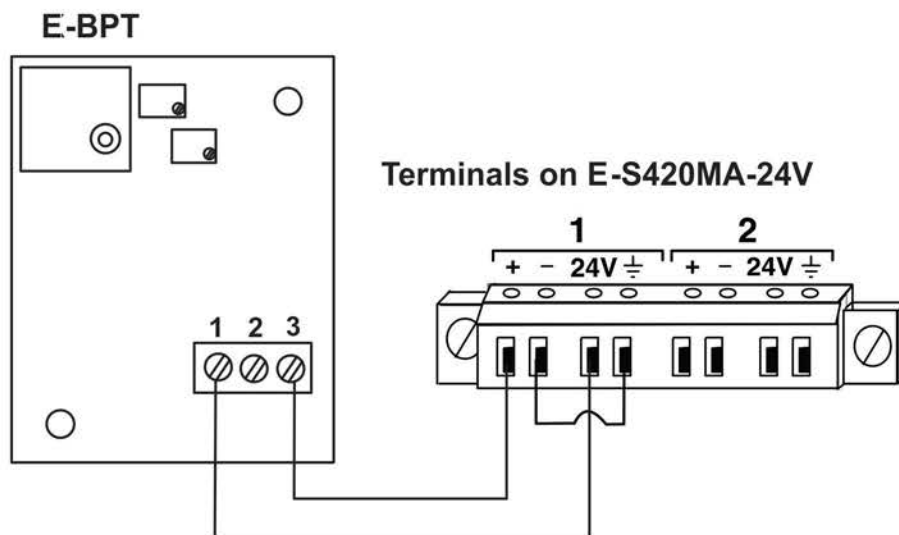

Section 7 - Barometric Pressure to Analog Output Calculations

Output Reference Table

in Hg	Psi	mm Hg	Current (mA)
32	15.72	813	20
31	15.23	788	18.57
30	14.73	762	17.14
29	14.24	736	15.71
28	13.75	711	14.29
27	13.26	686	12.86
26	12.77	660	11.43
25	12.27	634	10
24	11.79	610	8.57
23	11.3	584	7.14
22	10.8	558	5.71
20.8	10.2	527	4

☐ **Sensor Settings**

Description
Descriptive name for the sensor

Group ▼
Select which group the sensor belongs to

Min. Level
Min. supported value for the sensor

Max. Level
Max. supported value for the sensor

Associate Sensor
Associate sensor to a customized sensor type

Associated Sensor Type
Type of the associated sensor

Associated Sensor Unit
Measurement unit for the associated sensor

SNMP Associated Type ID
ID value for SNMP type of associated sensor

Min. Associated Level
Sensor expected value corresponding to 4mA

Max. Associated Level
Sensor expected value corresponding to 20mA

Min. Non-Critical Threshold
Min. threshold below which indicates a non-critical alert condition

Max. Non-Critical Threshold
Max. threshold above which indicates a non-critical alert condition

Min. Critical Threshold
Min. threshold below which indicates an alert condition

Max. Critical Threshold
Max. threshold above which indicates an alert condition

Refresh Rate ▼
The refresh rate at which the sensor view is updated

⊕ **Non-Critical Alert Settings**

⊕ **Critical Alert Settings**

⊕ **Data Logging**