




**NETWORK
TECHNOLOGIES
INCORPORATED**

1275 Danner Dr Tel:330-562-7070
Aurora, OH 44202 Fax: 330-562-1999
www.networktechninc.com

Duct Mount Temperature/Humidity Sensor Diagram

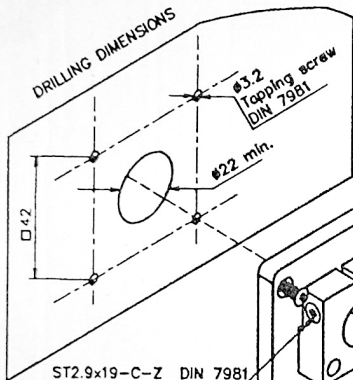


ST2.9x19-C-Z DIN 7981


ST4.2x16-C-Z DIN 7981
4 pcs

ELECTRICAL CONNECTIONS

HMD 40 U




HMD 40 Y




Spare part sensor
INTERCAP 15778 HM


Installing the cable seal



1. Press the rubber seal
in the hole.
2. Pierce the seal with the
cable or a screwdriver.




3. Pull the cable back to
lock it in position.
For cable diameter
7...10 mm.

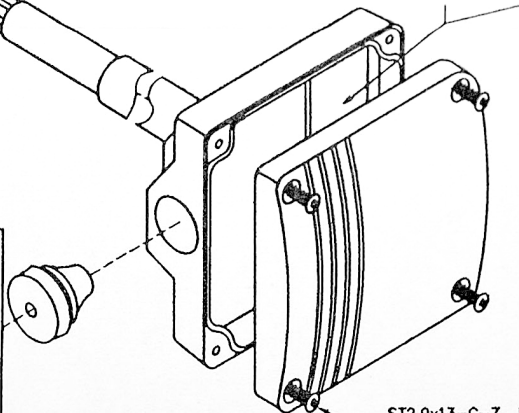

ST2.9x13-C-Z DIN 7981
4 pcs

HMD 50 U



HMD 50 Y

